




Gate Valve	
	New
	Remove and Replace
	To Remain
	Remove

Hydrant	
	New
	Remove and Replace
	To Remain
	Remove


Water Main	
	Replace
	To Remain

Water Services	
	Some services shown for clarification
	Building to be reconnected to water main

Other Utilities	
	Manhole
	Utility Pole

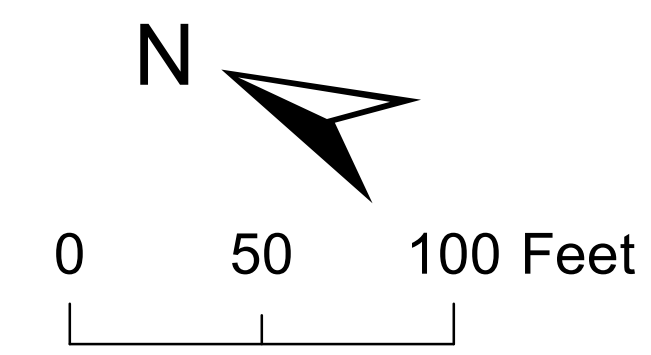

Ledgewood Drive

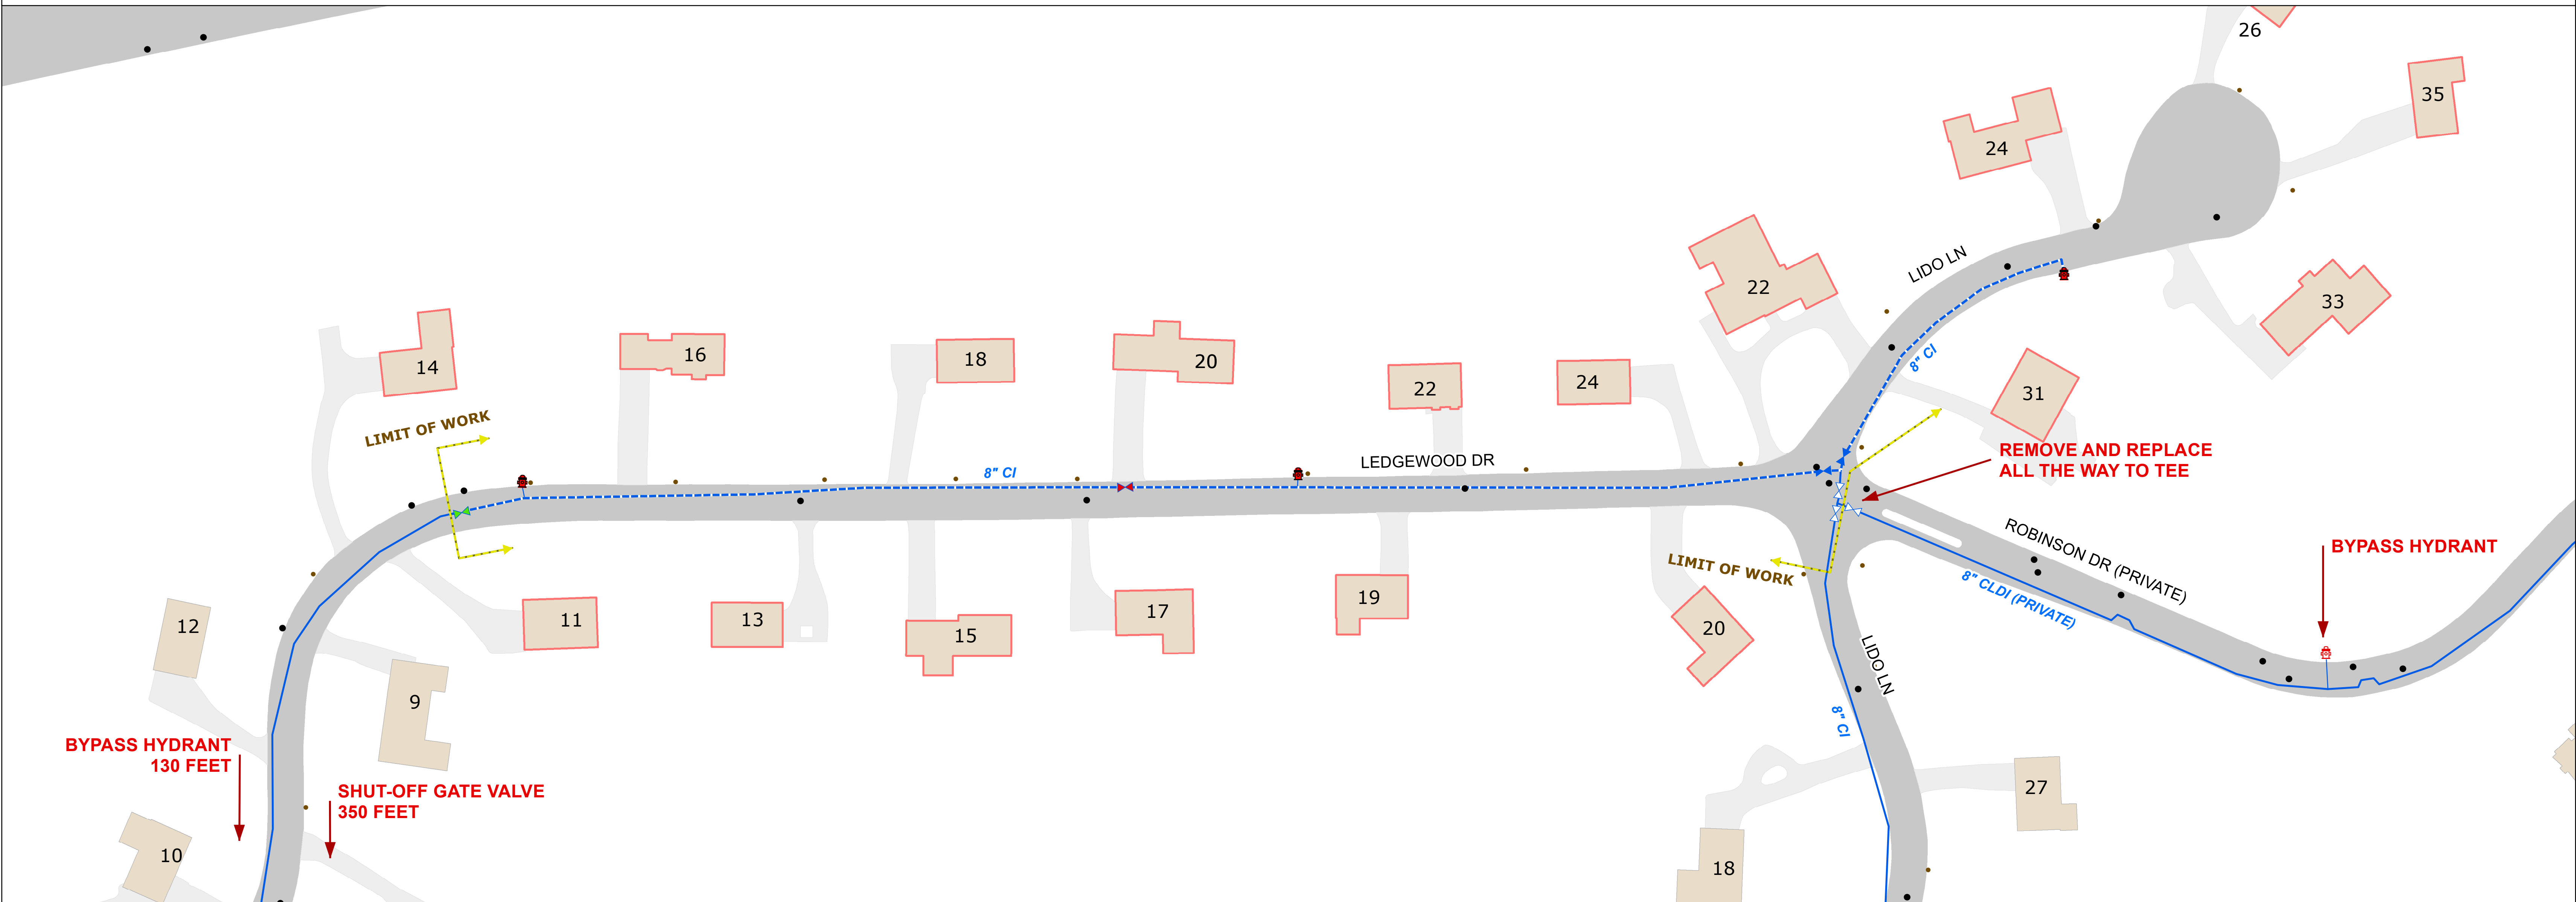

Notes:

1. Remove existing 8" CI and appurtenances and replace with 8" CLDI in same trench.
1. Provide bypass service to all affected properties.
2. The location of pipes and underground structures and utilities shown on these plans are not warranted to be exact nor is it warranted that all pipes, utilities or underground structures are shown. Exact locations to be determined by Contractor.
3. Underground utilities to structures are not shown.
4. Unless otherwise noted or directed by Engineer, any new water main shall cross under all existing pipe lines except culverts and sanitary sewers. Contractor shall maintain a minimum clearance of at least 12" between any new water main and all other existing utilities.
5. Exact location of new pipes, valves, fittings, etc. shall be determined by the Engineer.
6. Any lead or galvanized steel service, public or private, shall be reported to the Bedford Water Operations Manager.